

INSTALLATION INSTRUCTIONS

MODELS (-)XRD-RDCM3

HORIZONTAL AIRFLOW ECONOMIZERS

⚠ WARNING

THIS ACCESSORY IS TO BE INSTALLED BY A QUALIFIED, LICENSED SERVICE PERSON. TO AVOID UNSATISFACTORY OPERATION OR DAMAGE TO THE PRODUCT AND POSSIBLE UNSAFE CONDITIONS, INCLUDING ELECTRICAL SHOCK, REFRIGERANT LEAKAGE AND FIRE, THE INSTALLATION INSTRUCTIONS PROVIDED WITH THIS ACCESSORY MUST BE STRICTLY FOLLOWED AND THE PARTS SUPPLIED USED WITHOUT SUBSTITUTION. DAMAGE TO THE PRODUCT RESULTING FROM NOT FOLLOWING THE INSTRUCTIONS OR USING UNAUTHORIZED PARTS MAY BE EXCLUDED FROM THE MANUFACTURER'S WARRANTY COVERAGE.

⚠ WARNING

DISCONNECT ELECTRICAL POWER TO THE UNIT. FAILURE TO DO SO CAN CAUSE ELECTRICAL SHOCK RESULTING IN PERSONAL INJURY OR DEATH.


TOOLS REQUIRED FOR INSTALLATION:

$\frac{3}{8}$ " electric drill with $\frac{5}{16}$ " socket	Small flat blade (0.125" wide) screwdriver
Waterproof exterior duct sealant	Sheet metal tools (e.g. shears)

TABLE 1

PACKAGE CONTENTS		(-)XRD-RDCM3 economizer with controller, actuator, and outside enthalpy sensor attached
ITEM	DESCRIPTION	PART No.
1	Discharge Air Sensor (Hardware Bag)	6039413B / 3112
2	(2) Permanent Filters	6039413B / 8567 (11.875" X 23.875")
3	(2) Spotweld Assy - Bird Screen	6039413B / BSWA
4	(2) Exhaust Air Rainhood - Top	6039413B / EHT2
5	OA Rainhood Assy - Left Side	6039413B / EHSL
6	OA Rainhood Assy - Right Side	6039413B / EHSR
7	(2) Exhaust Air Rainhood - Left Side	6039413B / EHS3L
8	(2) Exhaust Air Rainhood - Right Side	6039413B / EHS3R
9	OA Rainhood Assy - Filter Bracket Strip	6039413B / ADP
10	OA Rainhood Assy - Top	6039413B / EHT
11	OA Rainhood - Front Filter Support	6039413B / EHB
12	OA Filter Rail	6039413B / FCH
13	Hardware Bag	6039413B / HDW

FIGURE 1

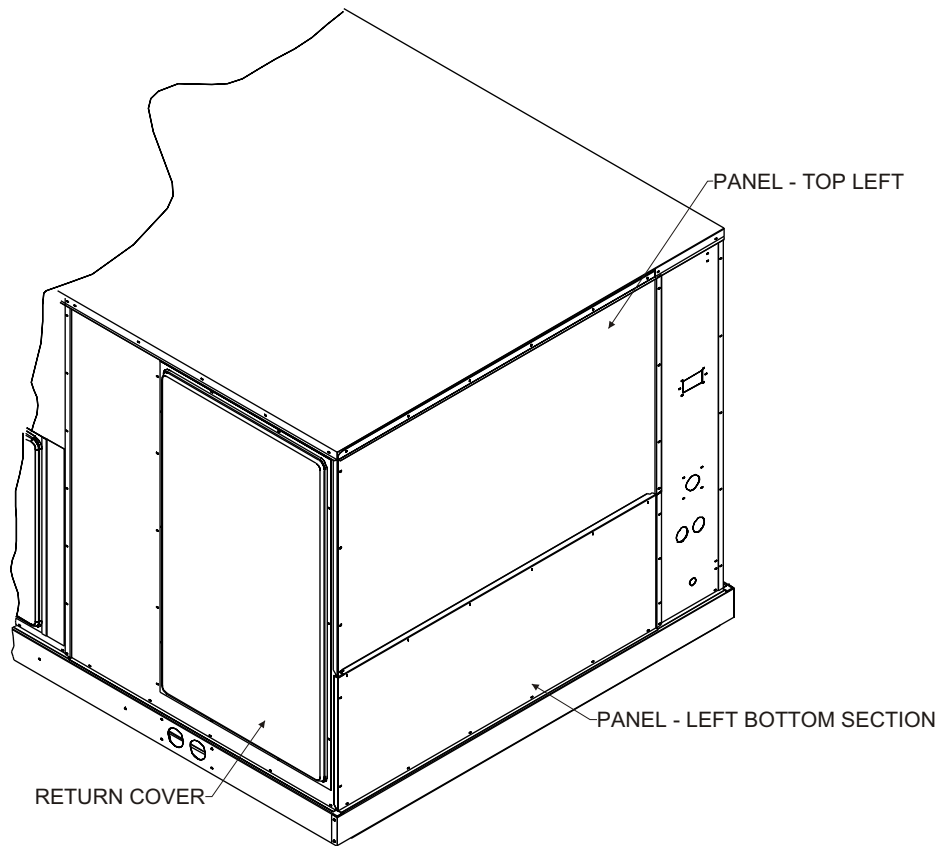

A1005-01

STEP 1:

Immediately upon receipt, all cartons and contents should be inspected for transit damage. Units with damaged cartons should be opened immediately. If damage is found, it should be noted on the delivery papers and a damage claim filed with the last carrier.

STEP 2:

Remove RETURN COVER, PANEL – TOP LEFT, and PANEL – LEFT BOTTOM SECTION from the unit and retain for reuse (**SEE FIGURE 1**). Retain screws.

STEP 3:

Fasten RETURN COVER (**SEE FIGURE 2**) over bottom return opening using 2 retained screws.


STEP 4:

Remove screws from 3 sides of ROOF PANEL so that it can be raised during economizer insertion.

STEP 5:

Remove jumper plug PL7 and connect unit ECONOMIZER PLUG to economizer mating plug and slide economizer into unit. Reinstall jumper plug PL7 to PL21 located on economizer.

FIGURE 2

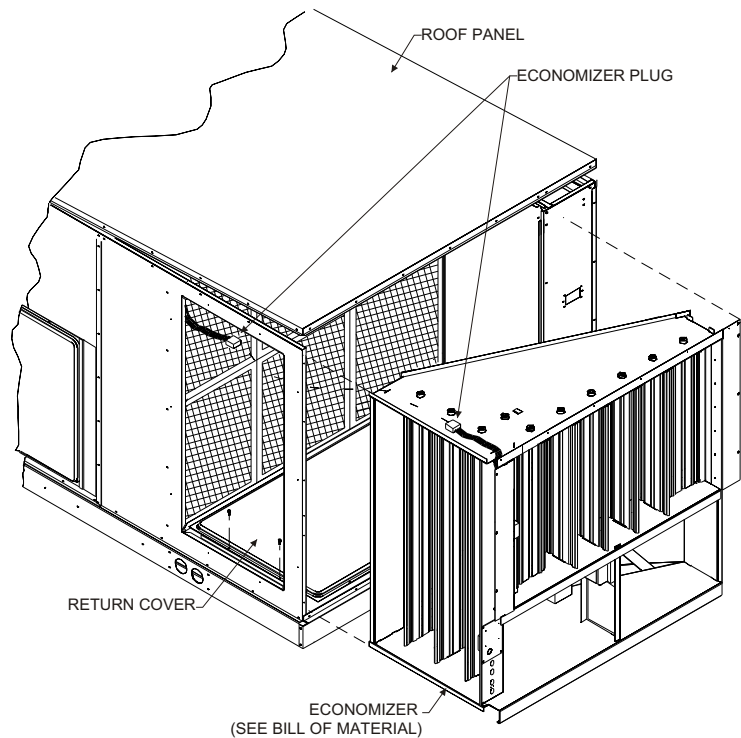

A1005-01

STEP 6:

Mount **PANEL – LEFT BOTTOM SECTION** to unit (**SEE FIGURE 3**). Use only 2 screws (one on each side) for easy removal during calibration.

STEP 7:

Fasten **⑨ FILTER BRACKET STRIP** to unit using 2 screws (one on each side). See **Table 1** for identification.

STEP 8:

Fasten **⑫ OA FILTER RAIL** to **⑨ FILTER BRACKET STRIP** with 4 screws.

STEP 9:

Fasten **⑤ OA RAINHOOD - LEFT SIDE** and **⑥ OA RAINHOOD - RIGHT SIDE** to unit using 2 screws provided.

STEP 10:

Slide **② PERMANENT FILTERS** between **⑤ OA RAINHOOD - LEFT SIDE** and **⑥ OA RAINHOOD - RIGHT SIDE** back into the **⑫ OA FILTER RAIL**.

STEP 11:

Fasten **⑪ OA RAINHOOD - FRONT FILTER SUPPORT** to **PANEL – TOP LEFT**. The bottom lip should support the **② PERMANENT FILTERS**.

STEP 12:


Fasten **PANEL – TOP LEFT** to **⑤ OA RAINHOOD - LEFT SIDE** and **⑥ OA RAINHOOD - RIGHT SIDE** and **⑪ OA RAINHOOD - FRONT FILTER SUPPORT** using 12 screws.

STEP 13:

Position the **⑩ OA RAINHOOD ASSY – TOP** under edge of **ROOF PANEL**.

STEP 14:

Re-secure **ROOF PANEL** using existing screws.

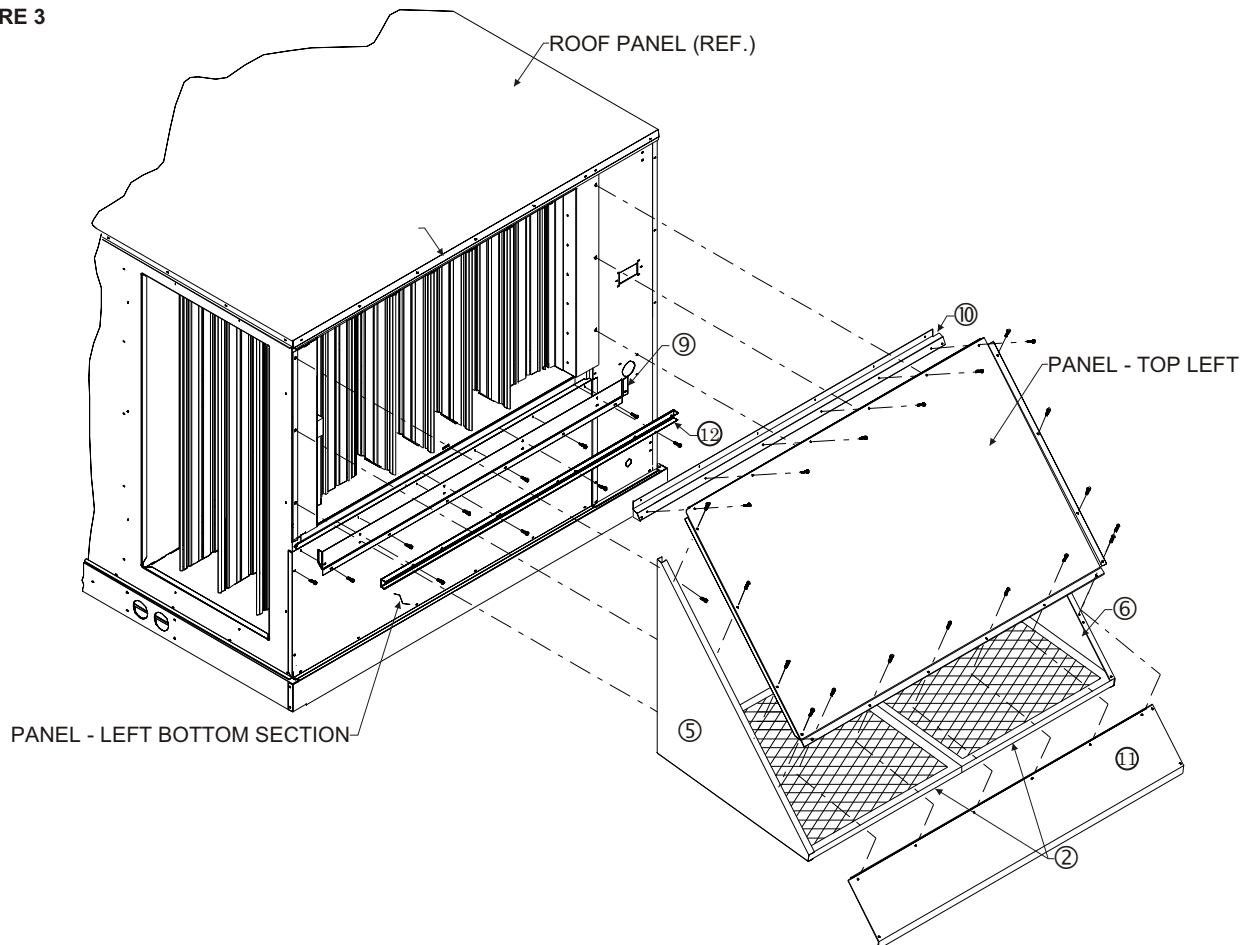FIGURE 3

A1012-01

STEP 15:

Provide opening in return air duct to mount the two barometric relief dampers and hoods (**SEE FIGURE 4**). Locate a convenient distance from unit.

STEP 16:

Using self-drilling screws provided, assemble exhaust air rain hoods (④ EXHAUST AIR RAINHOOD – TOP, ⑦ EXHAUST AIR RAINHOOD - LEFT SIDE, ⑧ EXHAUST AIR RAINHOOD - RIGHT SIDE, ③ SPOTWELD ASSY - BIRD SCREEN) and install in return air duct. Use sealant (not provided) as required.

STEP 17:

Remove the blower motor access panel (**SEE FIGURE 5**).

STEP 18:

Connect the ① DISCHARGE AIR SENSOR to wires 51 and 52 located in the blower motor compartment.

NOTE:


Mixed air sensor should be secured with the included wire tie to avoid entanglement with the blower and direct contact with any sheet metal surfaces.

STEP 19:


Replace the blower motor access panel.

STEP 20:

Upon start-up check the economizer sequence of operation using the steps provided in these instructions. After testing unit operation and setting outside air damper minimum position, secure PANEL – LEFT BOTTOM SECTION (**SEE FIGURE 3**) with remaining screws.

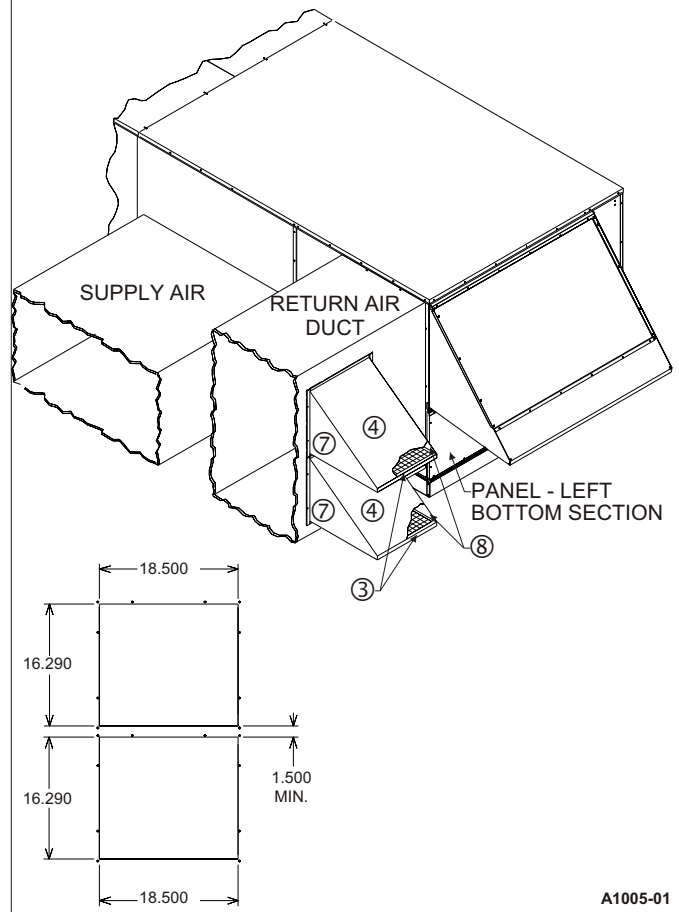FIGURE 4

A1005-01

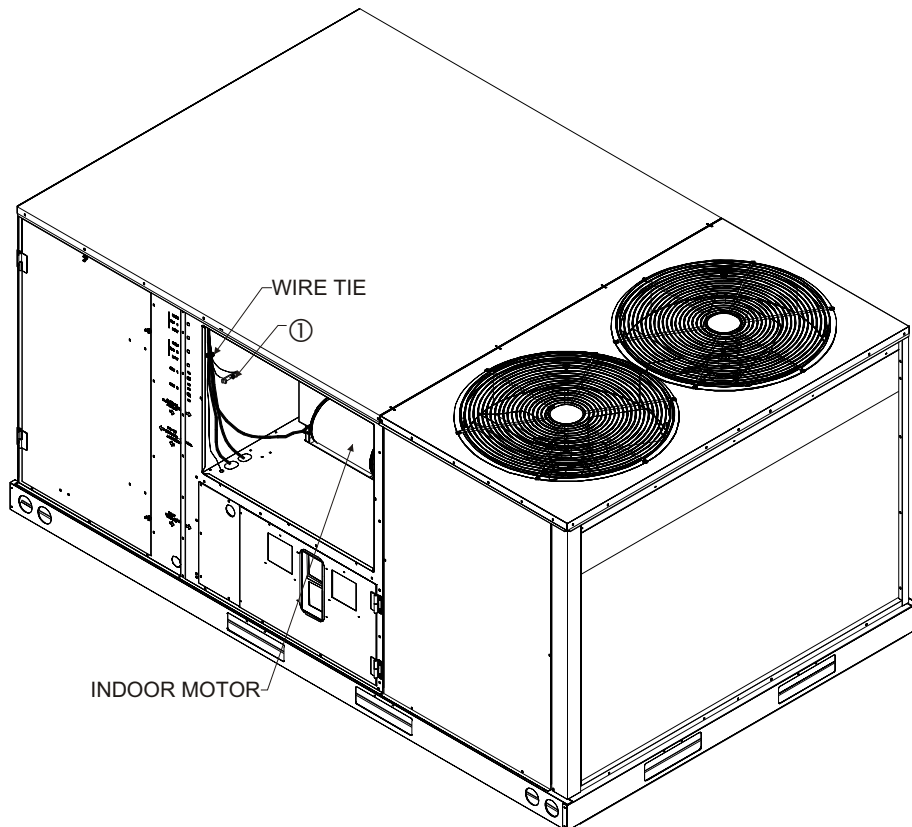FIGURE 5

DIRECT MOUNT ECONOMIZER SEQUENCE OF OPERATION

GENERAL

This accessory economizer package is designed to save energy costs by using outdoor air for cooling and ventilation in place of mechanical cooling whenever possible. The economizer continuously monitors indoor and outdoor air conditions and compares them to a user-selected setpoint to determine if free cooling is available.

ACCESSORIES

RXXR-AV02 — Dual Enthalpy Upgrade Kit

For maximum energy savings, this upgrade kit will allow the economizer to compare the outdoor air enthalpy to the return air enthalpy, instead of a user-selected setpoint to determine if "free cooling" is available.

RXXR-AR02 - Wall-Mounted Carbon Dioxide Sensor

For installations requiring Demand Control Ventilation (DCV) based upon indoor air levels of carbon dioxide (CO₂). When the unit supply fan is running, the CO₂ sensor modulates the outside air damper to maintain a user-selected CO₂ level inside the occupied space. Energy savings are achieved by not bringing in excessive amounts of outdoor air when the indoor air conditions are suitable. Energy savings can be substantial on buildings with highly variable occupancy rates.

Wall-Mounted Remote Potentiometer

For installations requiring remote adjustment of damper minimum position by the occupants, a remote potentiometer, such as the Honeywell S963B1128 can be used.

RXXR-BFF02C, RXXR-BFF02D, RXXR-BFF02Y — Power Exhaust Kit

For installations requiring more space static pressure relief than can be obtained with the standard barometric relief damper included with the economizer, a power exhaust kit can be added.

STARTUP

Attach connector from Economizer Controller to Rooftop Control Panel Connector and install discharge/mixed air temperature sensor per installation guide.

ADJUSTMENTS


5 potentiometers with screwdriver adjustment slots, starting from top of controller

1. EXH Set — Adjustments for (optional) power exhaust
 - A. The outside air damper position at which the power exhaust fan(s) will engage. The LED labeled EXH below the potentiometer adjustment will indicate when power exhaust is available. When the power exhaust call is made, the controller provides a 60 ±30 second delay before exhaust fan activation to allow the damper to reach the appropriate position.

- B. Range of adjustment is from 0-100% (2-10V); in most applications the power exhaust is set to engage at about 70% outside air.

2. Min Pos — Outside Air Damper minimum position
 - A. Adjust the minimum position potentiometer to allow the minimum amount of outdoor air, as required by local codes, to enter the building.B. Range of adjustment is from 0-100% (2-10V); in most applications the minimum position is adjusted to allow 10% to 25% outside air to enter the system
 - B. Range of adjustment is from 0-100% (2-10V); in most applications the minimum position is adjusted to allow 10% to 25% outside air to enter the system.
 - C. The Outside Air Damper Minimum Position potentiometer can be adjusted at any time.
 - D. Whenever the "G" (supply fan) signal is present, the damper will open to this minimum position unless:
 - a. It may modulate to a greater position if overridden by the CO₂ sensor (DCV).
 - b. It may not open if overridden by the discharge air temperature sensor (Freeze Protect Mode).
3. DCV Max — Demand Control Ventilation (DCV) Maximum Setpoint
 - A. The DCV maximum position potentiometer allows the installer to limit the amount of outdoor air flow into the building when the DCV overrides the mixed air sensor.
 - B. Setting the DCV maximum position of the damper prevents the introduction of large amounts of hot or cold air into the space.
 - C. Note: If the DCV maximum position is set below the outside air damper minimum position, the minimum position overrides the DCV maximum position (negating the function of the DCV).

FIGURE 6

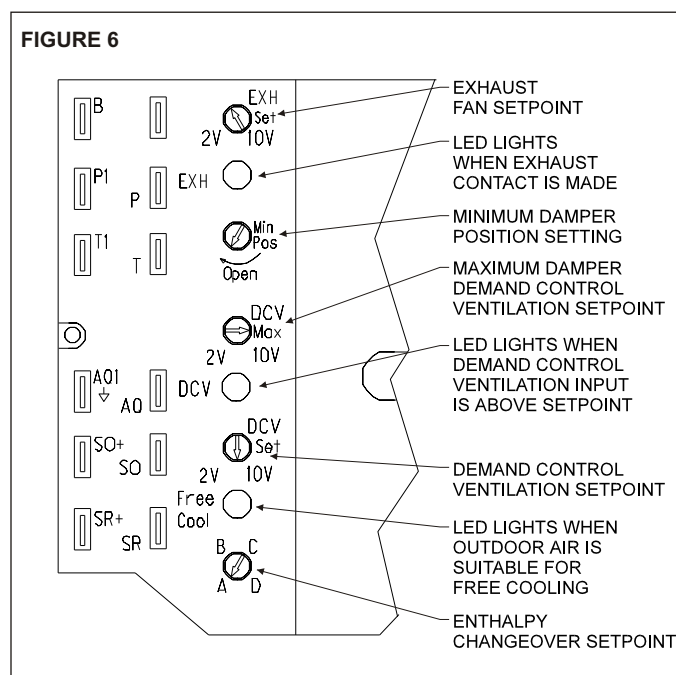


4. DCV Set — Demand Control Ventilation (DCV) Setpoint

- The DCV can be any sensor that provides a 2-10Vdc output. The DCV modulates the outdoor damper to provide ventilation based on occupancy. Typically, a carbon dioxide (CO₂) sensor is used to indirectly monitor occupancy level.
- No cooling signal (e.g. Y1, Y2) is required for the DCV to override the outdoor air damper when ventilation requires outdoor air.
- The controller must receive a "G" (supply fan) signal to open the damper.
- Range of adjustment is from 2 Volts to 10 Volts.
- The DCV setpoint can be adjusted at any time.
- The controller compares the CO₂ sensor input to the setpoint setting to determine the damper minimum position.
 - If the actual CO₂ level is below the setpoint, then the damper minimum position is determined by the damper minimum position potentiometer setting.
 - If the actual CO₂ level rises above the setpoint, then the damper minimum position is overridden proportionally more open.
 - If the discharge air temperature drops below 48°F (Freeze Protect Mode), the DCV input will be overridden and the damper may not open.
- Compatible CO₂ sensors will have a 2-10Vdc output for a 0-1500 ppm CO₂ input.
- Ensure proper polarity of the sensor wires when connecting to the economizer controller. Incorrect polarity negates the sensor signal.

5. Economizer Setpoint

- Only the coolest, driest outside air is used for economizer operation when the potentiometer is on setting "D". For greatest energy savings, the potentiometer is on setting "A".
 - Adjustment range is A, B, C, or D
 - Setting "A" = 73F db or 27 Btu/lbm @ 50% RH
 - Setting "B" = 70F db or 25 Btu/lbm @ 50% RH
 - Setting "C" = 67F db or 23 Btu/lbm @ 50% RH
 - Setting "D" = 63F db or 22 Btu/lbm @ 50% RH
 - Economizer Setpoint potentiometer can be adjusted at any time.
 - The controller compares the enthalpy sensor input with the economizer setpoint to determine if free cooling is available.
 - Single enthalpy strategy: If outdoor air enthalpy is lower than the setpoint, then free cooling is available. Note: The factory-installed 620-ohm resistor must be in place across terminals SR and SR+.
 - Dual enthalpy strategy: If outdoor air enthalpy is lower than return air enthalpy, then free cooling is available.
1. Note: If using dual enthalpy, the Economizer Setpoint must be at the "D" setting.

FIGURE 7

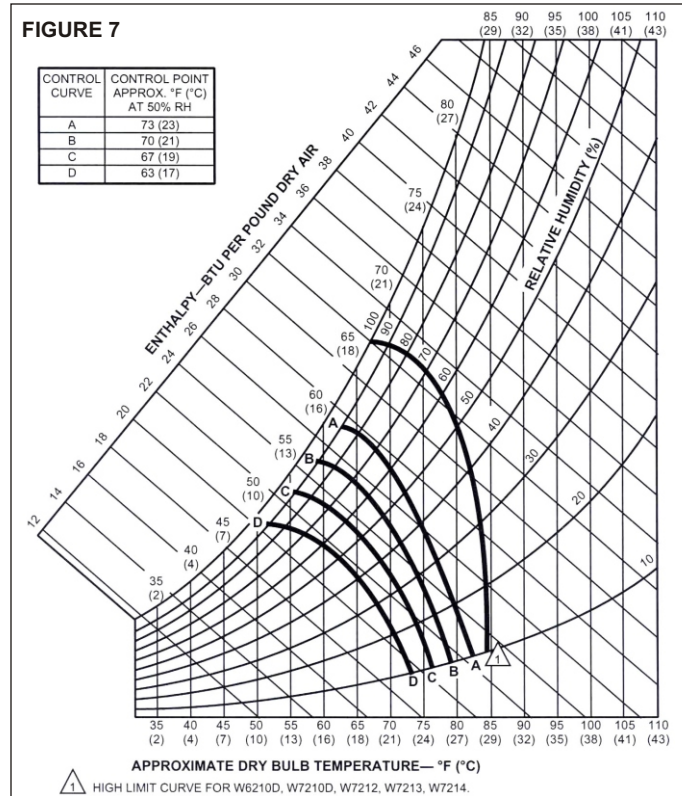

- The factory-installed 620-ohm jumper must be removed to install the dual enthalpy upgrade kit.

NORMAL OPERATION


- Fan Only (G)
 - Damper will go to minimum position (in 90 seconds or less) whenever the "G" (supply fan) signal is present.
 - When "G" signal is removed, the outside air damper closes against blade seals for tight shutoff of outside air.
 - If the discharge air temperature drops below 48°F, then the control will override the minimum position setting and will modulate the outside air damper closed.
- Call for First Stage of Cooling (Y1)
 - Economizer Unavailable (warm outdoor air). Compressor 1 is commanded on without delay.
 - Economizer Available (free cooling). The controller tries to maintain a discharge air temperature of 53°F ± 5 by modulating the outside air damper position.
- Call for Second Stage of Cooling (Y2)
 - Economizer Unavailable (warm outdoor air). Compressor 2 is commanded on without delay.
 - Economizer Available (free cooling). Compressor 1 is commanded on without delay. The controller tries to maintain a discharge air temperature of 53°F ± 5 by modulating the outside air damper position. Compressor 2 is not activated in the economizer mode.

4. Call for Heat
 - A. Standard Air Conditioner with electric or gas heat. (W1 & W2)
 - a. The Thermostat controls the stages of heating directly.
 - b. If the control detects that the supply fan is on (through its "G" input), then the control will open the damper to minimum position.
 - c. If the discharge air temperature drops below 48°F, then the control will override the minimum position setting and will modulate the outdoor damper closed.
 - B. Heat Pump Operation (B)
 - a. The "B" signal from the Thermostat allows operation of the compressors to provide heating without delay.
 - b. If the control detects that the supply fan is on (through its "G" input), then the control can open the damper to minimum position.
 - c. If the discharge air temperature drops below 48°F, then the control will override the minimum position setting and will modulate the outdoor damper closed.
5. Low Ambient Compressor Lockout – None present.


TROUBLESHOOTING

1. Checkout requires a handheld multimeter, 9V battery, a 5.6k ohm .25 watt resistor, a 1.2k ohm .25 watt resistor, a jumper wire with .25" quick connect terminals, and the 620 ohm resistor that is factory-installed across terminals SR+ and SR. The terminal names below reference the economizer controller. Use the following flowcharts for to diagnose unit.
2.
 - a. Disconnect power to the unit.
 - b. Jumper P to P1 (factory installed jumper is normally present).
 - c. Remove outdoor air enthalpy sensor from terminals SO+ and SO and install the 1.2k ohm resistor.
 - d. Put 620 ohm resistor across terminals SR+ and SR (factory installed 620 ohm resistor is normally present and can be used).
 - e. Put 5.6k ohm resistor across T and T1.
3.
 - a. Turn (**EXH Set**) Exhaust fan Setpoint potentiometer fully CCW.
 - b. Turn (**Min Pos**) Minimum Outside Air Damper potentiometer fully CCW.
 - c. Turn (**DCV Max**) Demand Control Ventilation Maximum potentiometer fully CW.
 - d. Turn (**DCV Set**) Demand Control Ventilation Setpoint potentiometer fully CCW.
 - e. Turn enthalpy potentiometer to "D".

BASIC ECONOMIZER OPERATION

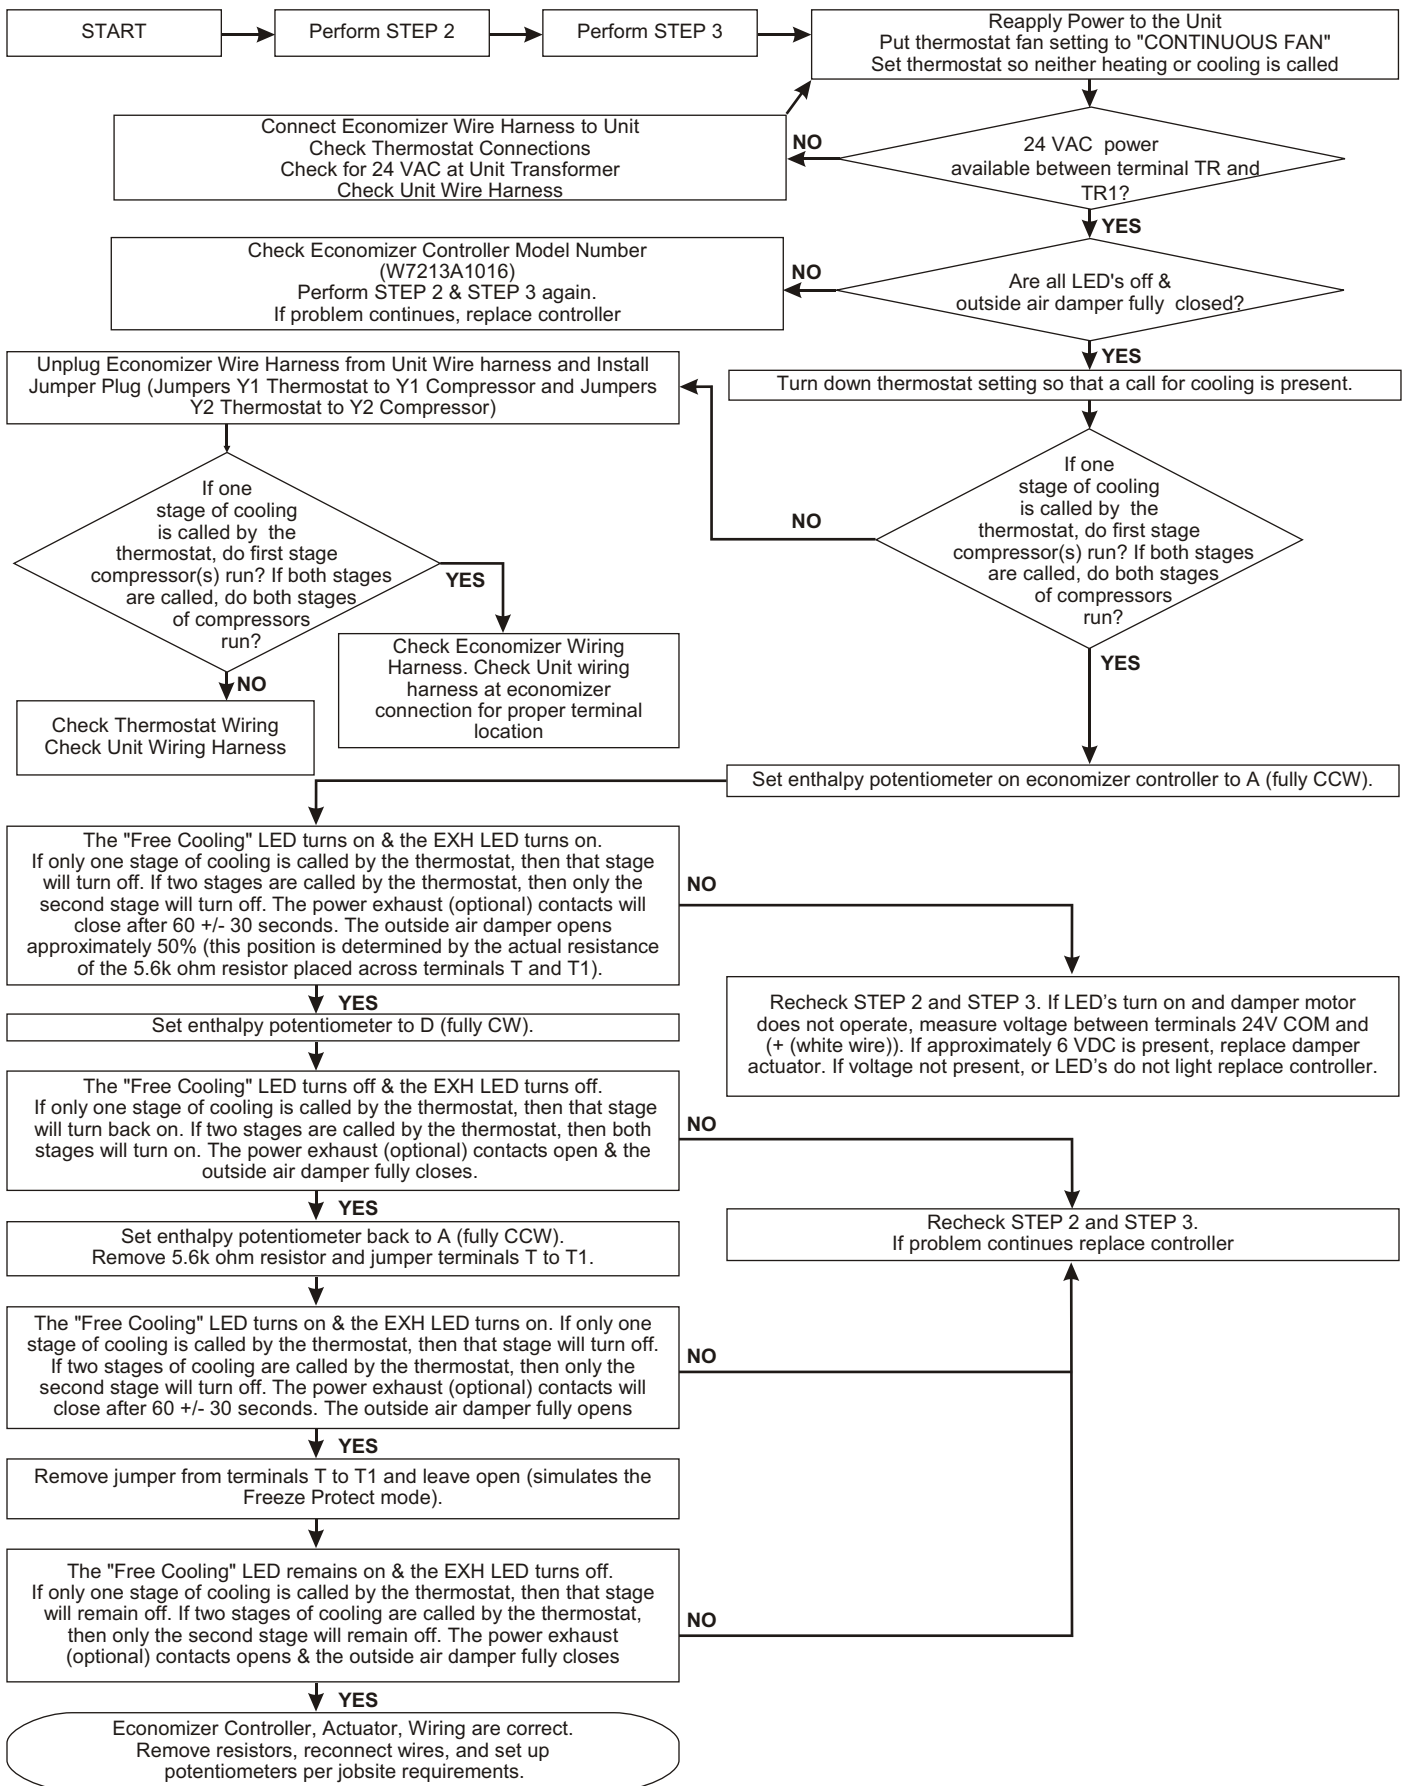


HEAT PUMP OPERATION (Perform BASIC ECONOMIZER OPERATION check first)

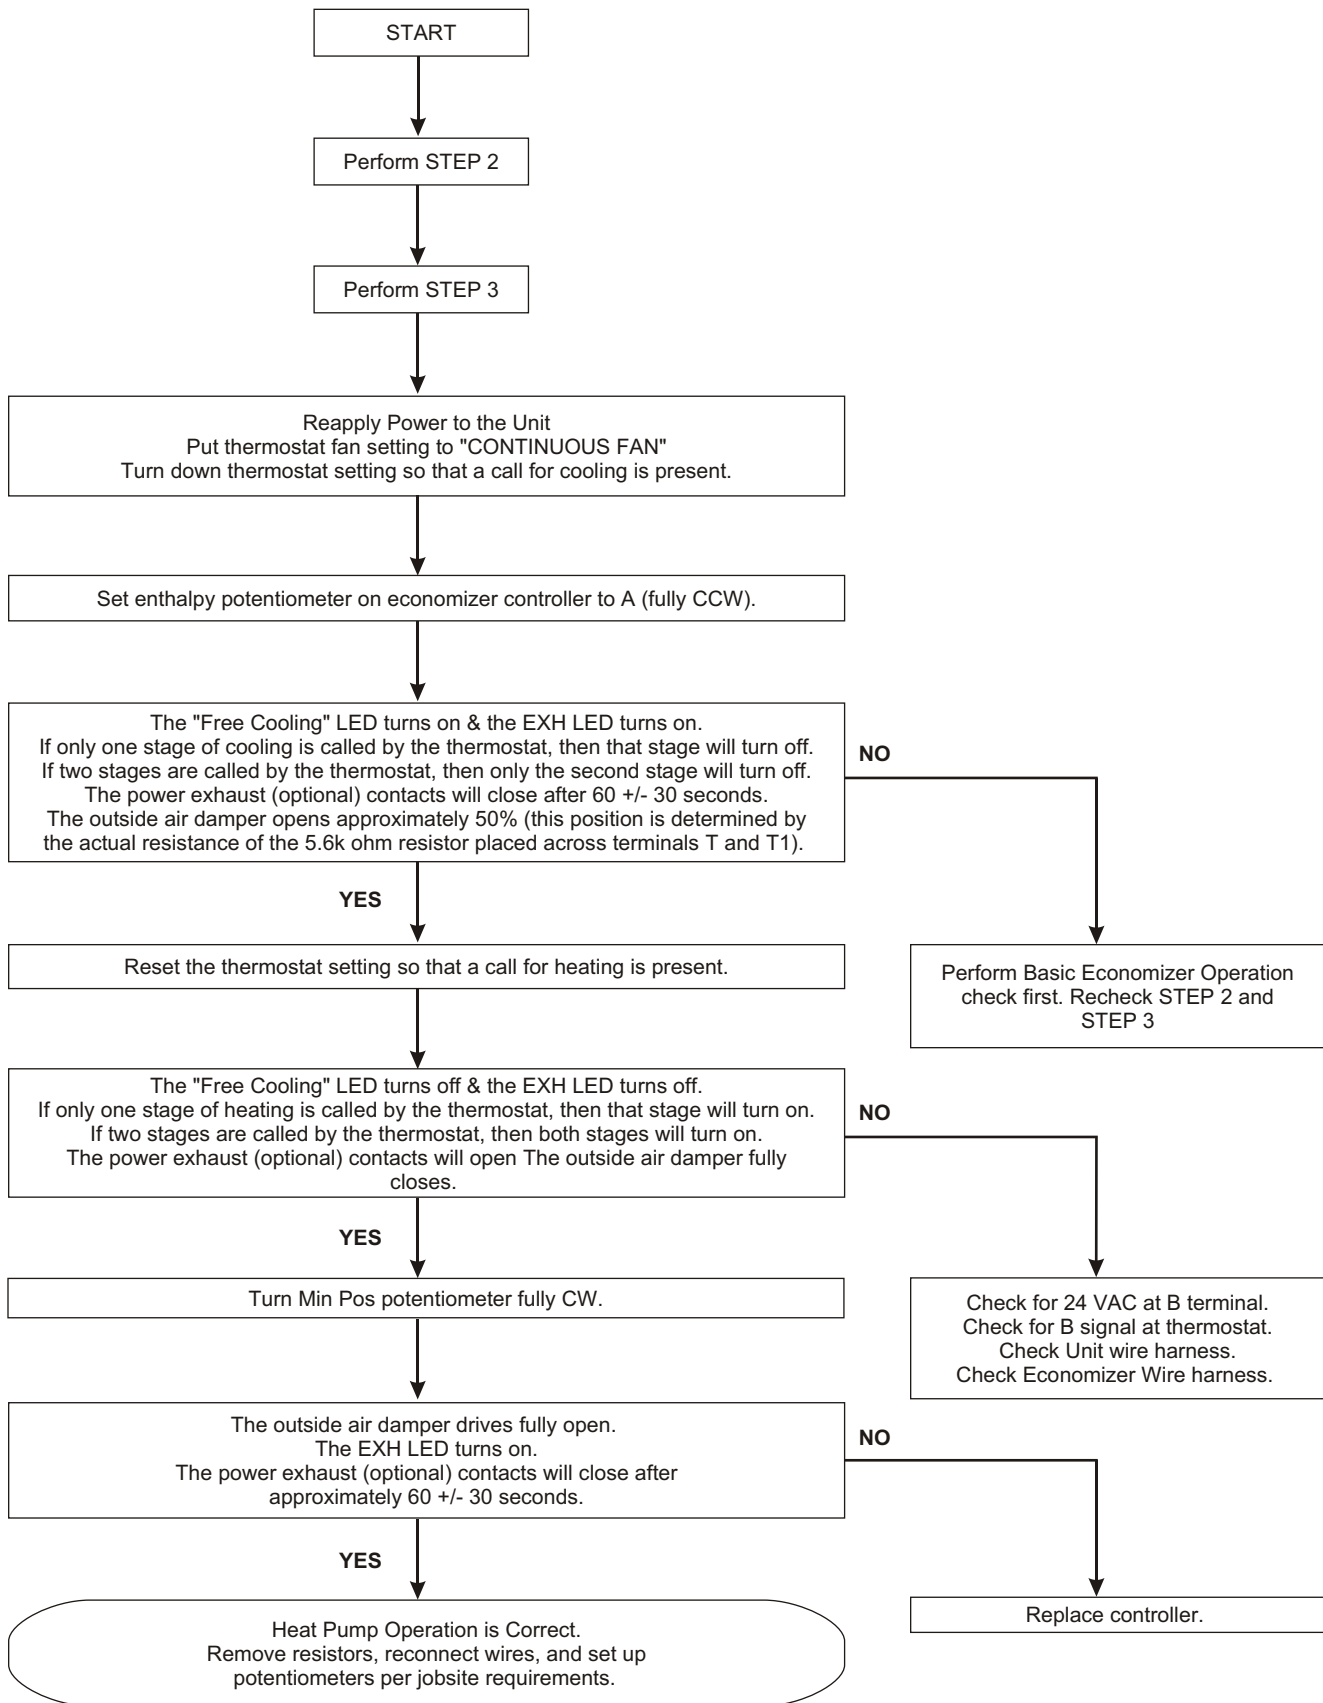

Use the following graph and the multimeter to verify proper operation of the mixed air / discharge air temperature sensor.

Measure the resistance (ohms) of the mixed air / discharge air temperature sensor with the multimeter. Look up the equivalent temperature on the graph. This should be the same as temperature the mixed air / discharge air sensor is detecting. If it is not, replace the mixed air / discharge air sensor.

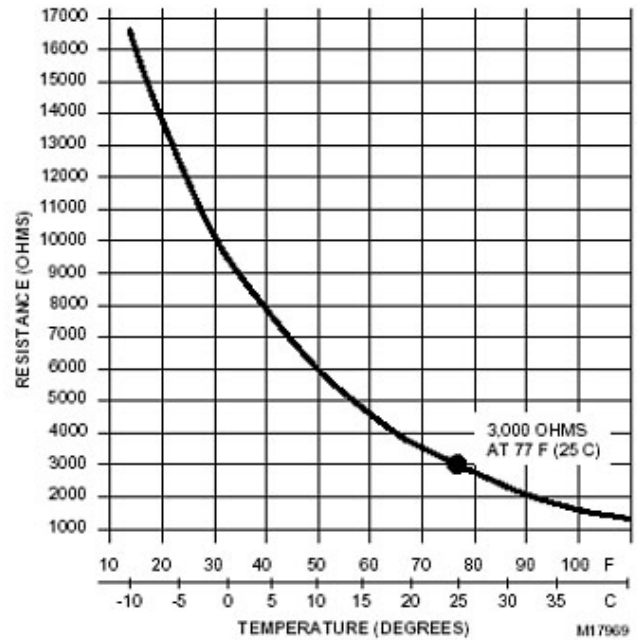

NOTES

1. The mist eliminator (Permanent Outdoor Air Filter), is of aluminum mesh construction and should be cleaned by flushing regularly with warm soapy water. The replacement mist eliminator size is listed on the first page of these instructions.
2. When diagnosing the system, the best results are obtained by first putting the fan setting on the Thermostat to the "Continuous Fan" mode.
3. Operation of the optional power exhaust only depends upon the supply fan running and the damper position (it is possible to set the minimum position high enough to engage the power exhaust in the heating mode).
4. This economizer requires a two-stage thermostat.
5. Upon loss of power to the unit or economizer, the outside air damper will spring close shut in about 5 seconds.
6. Compressor Time Delays, Compressor Interstage Delays, Compressor Low Ambient Lockouts, etc. are not provided by the economizer controller.

HARNESS ENDS AT PL6 & PL7


COMPONENT CODE

C7400A	Fresh Air Sensor
9RT1H	Mixed Air Sensor
J2	Power Exhaust Cap
MS7106K	Damper Actuator 24v
PL6	Male A/C Unit Plug
PL7	Female A/C Unit Plug
PL20	Female Economizer Cap
PL21	Male Smoke Plug
W7213A	Logic Module

WIRE COLOR CODE

BLK	Black	BLU	Blue
BRN	Brown	GRN	Green
GRY	Gray	ORG	Orange
PNK	Pink	RED	Red
TAN	Tan	VIO	Violet
WHT	White	YEL	Yellow

Revision	Change	Date
A	ECN# 2265	07-09-09
B	ECN# 5938	08-18-11
C	ECN# 6467	05-01-13

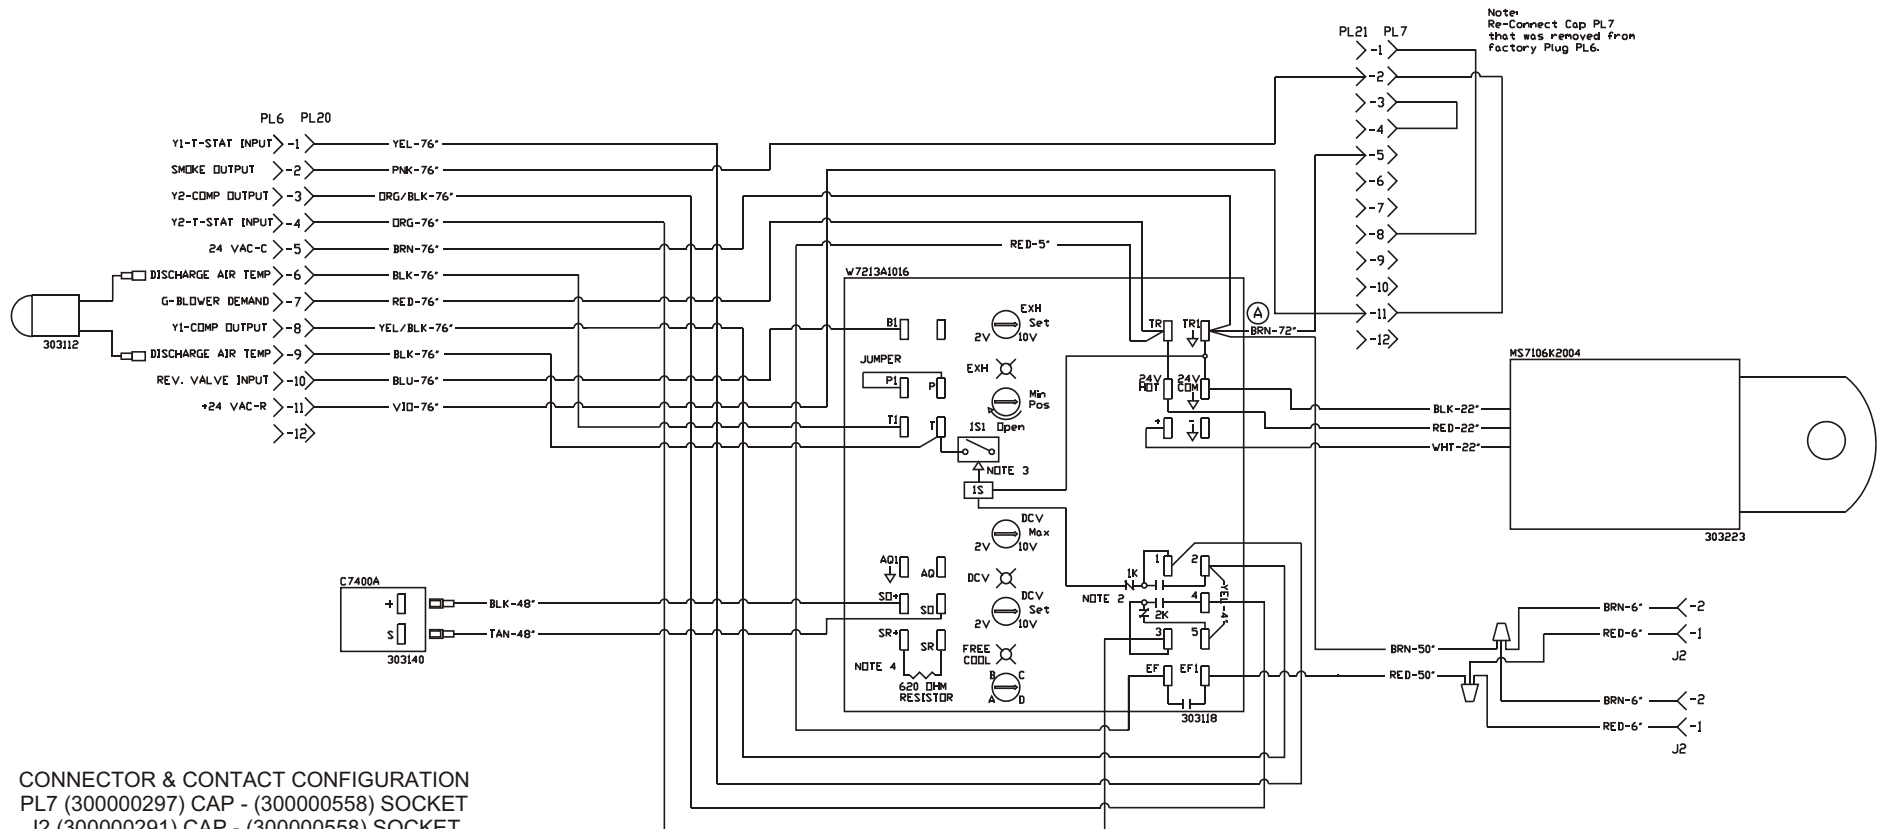

Notes:

- Unit wiring shown as reference only. Check unit wiring for actual unit wiring.
- Relays 1K and 2K actuate when the Outdoor Air Enthalpy is lower than the Return Air Enthalpy.
- 1S is an electronic switch which closes when powered by a 24 VAC input.
- Factory installed resistor should be removed only if C7400 Differential Enthalpy Sensor is added.
- Y2 must be energized for the compressor to operate.

Horizontal Modulating Gear Economizer RKNL / RLNL 072-150

RRS ROOFTOP
SYSTEMS
A Ruskin Company

1625 Diplomat Drive
Carrollton, Texas 75006
Phone: (972) 247-7447
Fax: (972) 243-0940

Date: May 1, 2013
 Supersedes: 08-18-11
 Drawn by: MGL
 Unit #: 60-394-13B
 Diagram#: 6039413BW
 Approved by:

